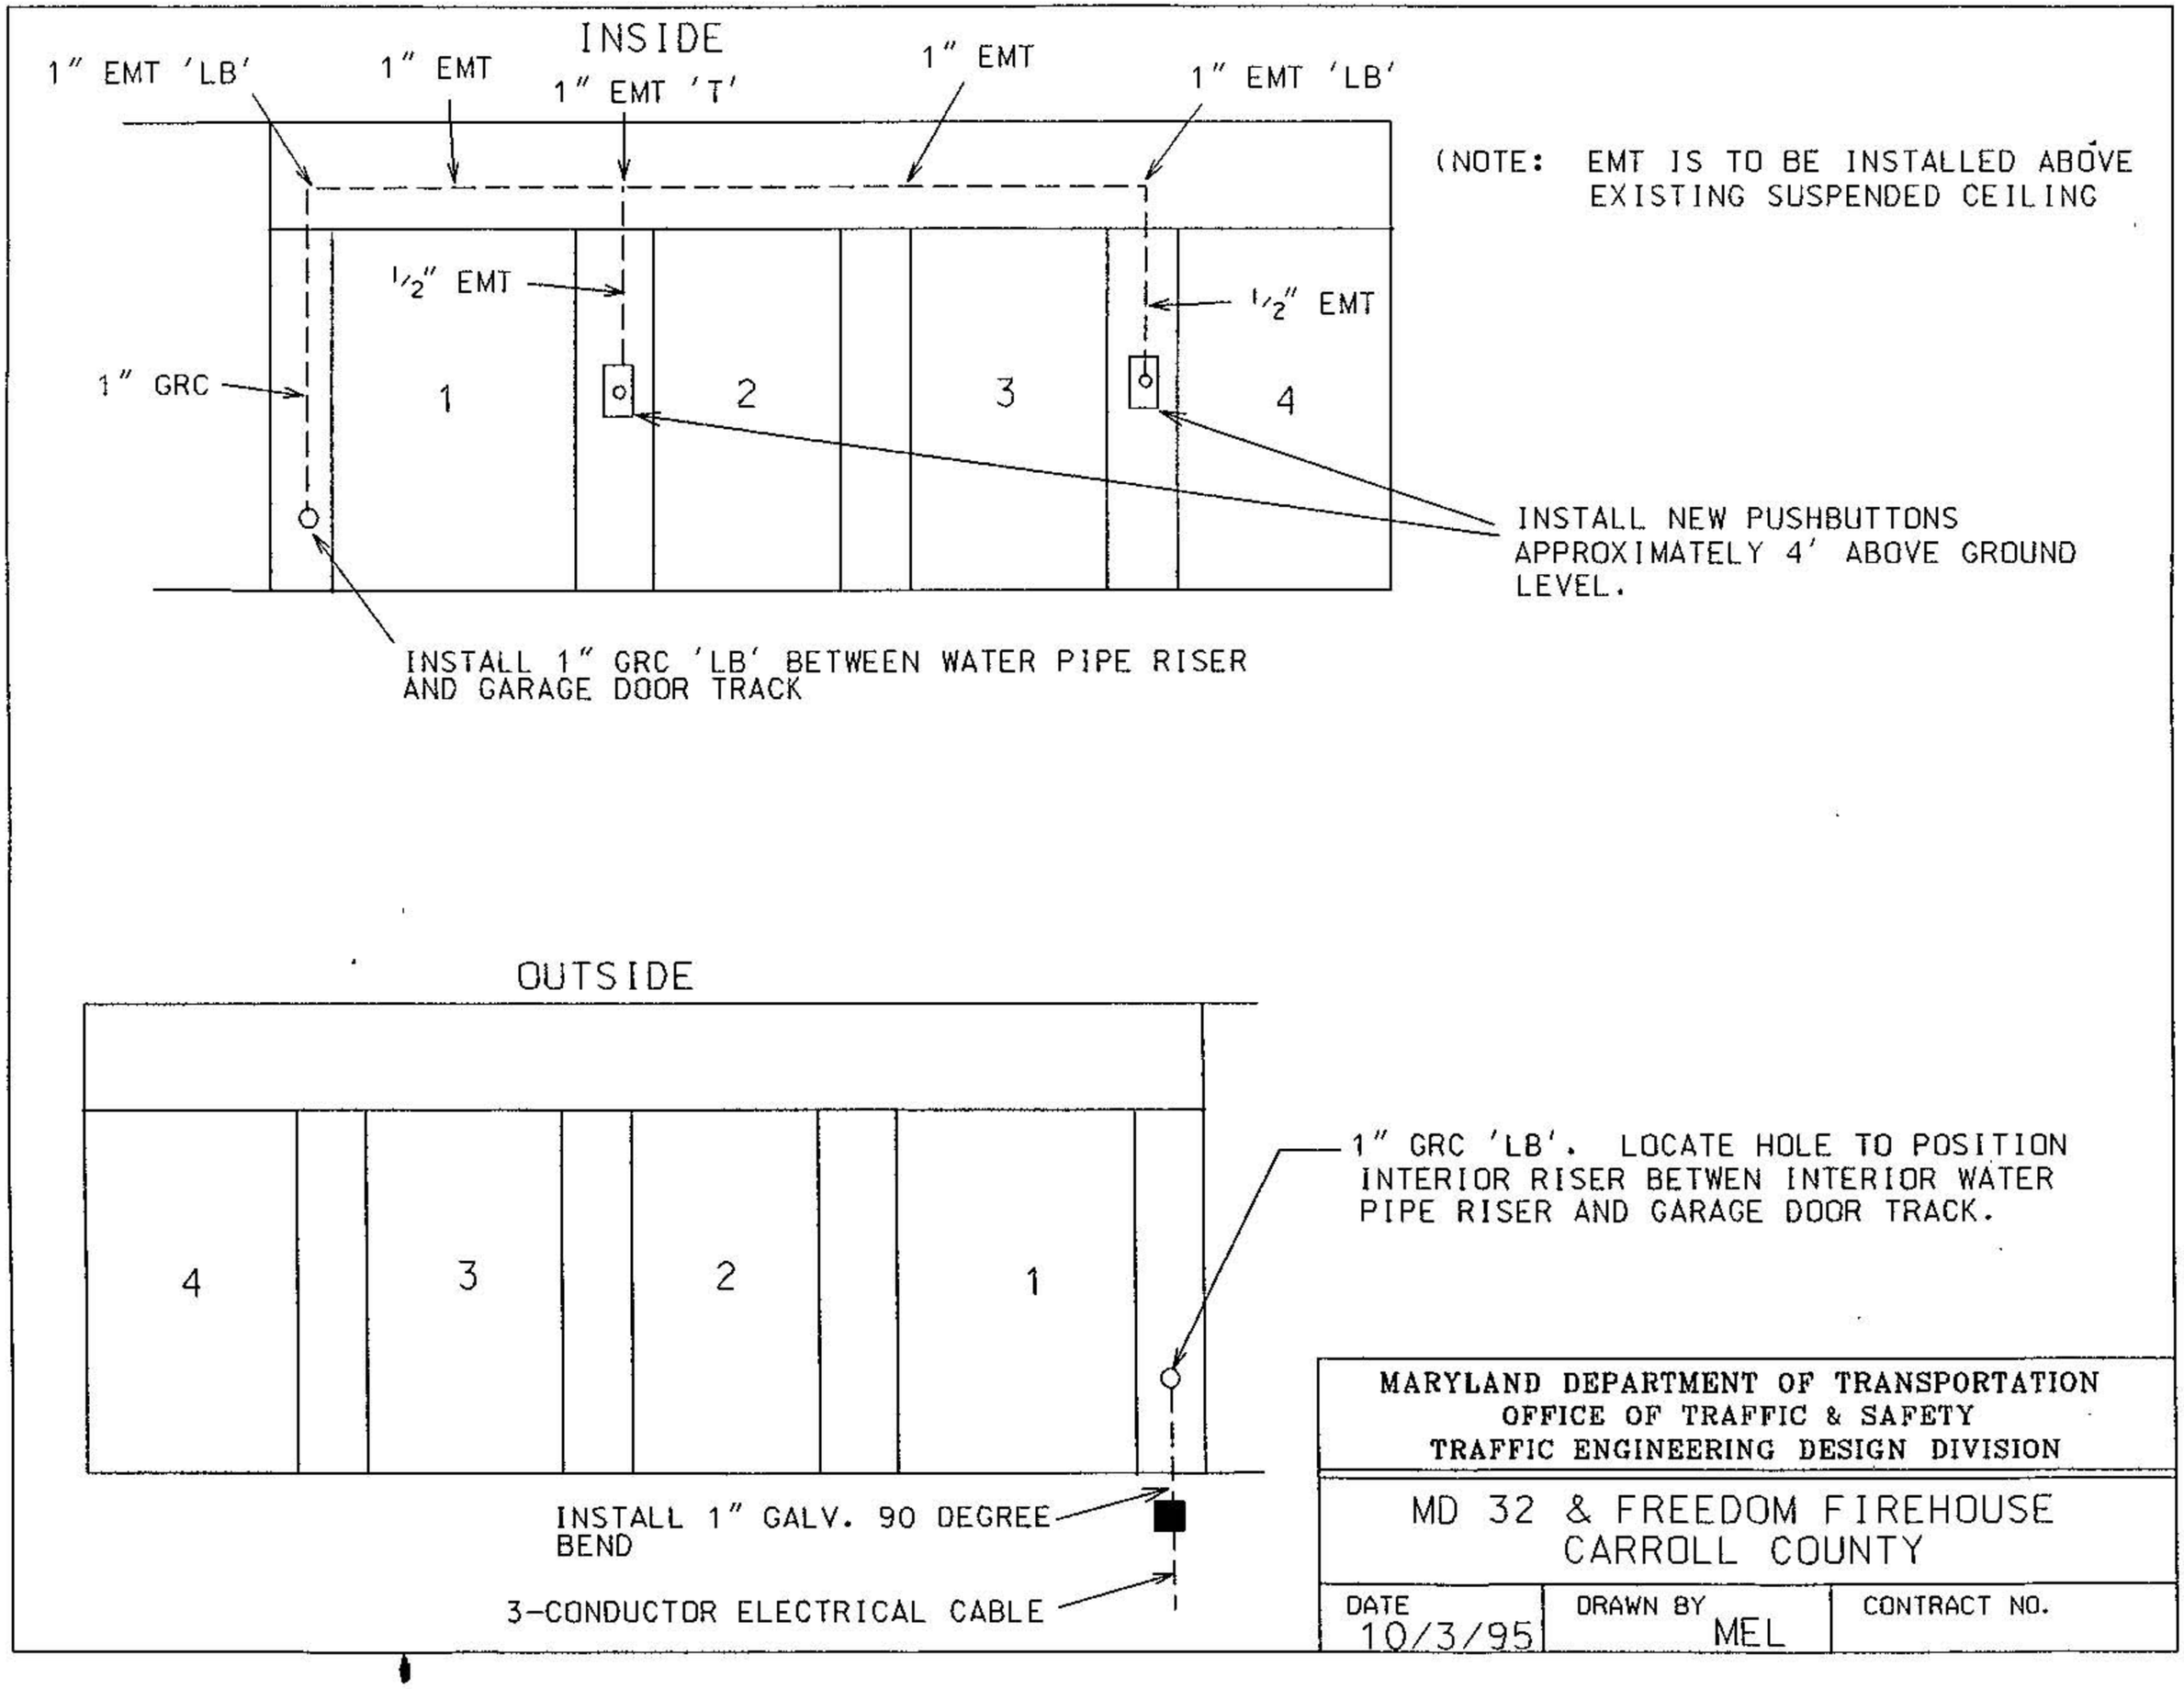
INSIDE
1" EMT 'LB'
1" EMT
1" EMT 'T'
1" EMT
1" EMT 'LB'
(NOTE: EMT IS TO BE INSTALLED ABOVE EXISTING SUSPENDED CEILING
1/2" EMT
1/2" EMT
1" GRC
1
2
3
4
INSTALL NEW PUSHBUTTONS APPROXIMATELY 4' ABOVE GROUND LEVEL.
INSTALL 1" GRC 'LB' BETWEEN WATER PIPE RISER AND GARAGE DOOR TRACK
OUTSIDE
4
3
2
1
1" GRC 'LB'. LOCATE HOLE TO POSITION INTERIOR RISER BETWEN INTERIOR WATER PIPE RISER AND GARAGE DOOR TRACK.
INSTALL 1" GALV. 90 DEGREE BEND
3-CONDUCTOR ELECTRICAL CABLE
MARYLAND DEPARTMENT OF TRANSPORTATION
OFFICE OF TRAFFIC & SAFETY
TRAFFIC ENGINEERING DESIGN DIVISION
MD 32 & FREEDOM FIREHOUSE
CARROLL COUNTY
DATE 10/3/95
DRAWN BY MEL
CONTRACT NO.